



PF2200-DB
OPERATOR GUIDE



PROFIRE

PF2200-DB-OPERATOR GUIDE

DOC-001112_REV 1.0

© 2020 PROFIRE ENERGY INC.

PROFIREENERGY.COM

PF2200-DB

OPERATOR GUIDE

TABLE OF CONTENTS

INTRODUCTION	02
PF2200-DB BMS Controller	02
APPROVALS AND RATINGS	03
CONTROLLER INTERFACE	04
TEMPERATURE SETTINGS	06
INPUT SETTINGS	07
PROCESS CONTROL SETTINGS	07
SETTINGS MODIFICATION	08
Drop down menu settings	08
Numeric settings	09
SYSTEM TOOLS	10
The Event Log screen	10
The Data Logging tool	10
The Status Priority tool	11
The PF2200-DB Diagnostic menus	11
OPERATING SEQUENCE	12
State table	12
State diagram	13
TROUBLESHOOTING	15

INTRODUCTION

PF2200-DB BMS CONTROLLER

The PF2200-DB Burner Management System is an automated safety controller designed to monitor and control industrial heating processes that utilize dual burner natural draft appliances. It provides for safe burner ignition, ionization flame detection, temperature control and peripheral input device monitoring. The user interface provides real-time system status and state information as well as detailed alert annunciation, advanced diagnostics and data logging. The system has been optimized for power consumption to be utilized in a variety of applications and can be monitored remotely.



This document provides a brief overview of the interface, operating sequence and functionality of the PF2200-DB BMS controller. Refer to the PF2200-DB Product Manual on the Profire website at profireenergy.com for detailed descriptions of the inputs, outputs and operating sequence as well as installation, maintenance and commissioning instructions. This document is applicable for the following hardware and firmware versions:

APPLICABLE HARDWARE AND FIRMWARE VERSIONS

This document is applicable for the following hardware and firmware versions:

PF2200-DB Firmware Version: **DB 1.0.3**

BMS Card Hardware Version **V2.3**

UI Card Hardware Version **V3.2**

SYSTEM		A - Ready
SYSTEM FW Info		B - Ready
BMS Bundle Version	DB 1.0.3	
BMS Hardware Model	2200-02	
BMS Product Variant	Dual Burner	
BMS Firmware Version	v1.0.3	
BMS Bootloader Version	v1.1.1	
BMS BOM Version	v2.3.0	
BMS Region Code	North America	
BMS Serial Number	93000-0000-xxxx	
BMS Manufacture Date	YYYY-MM-DD	
BMS Test Date	YYYY-MM-DD	
BMS PFN Version	v1.0.3	

Refer to the controller's Information Screen (*System > Firmware > Info*) to find the hardware and firmware versions of your system.

APPROVALS AND RATINGS

THE PF2200-DB IS CERTIFIED TO THE FOLLOWING STANDARDS



SIL 2 Capable

IEC 61508: 2010 Parts 1-7

Approved for use in a 1oo1 deployment configuration



Type 4X

CSA C22.2 No. 94.1:15 • CSA C22.2 No. 94.2:15, Ed. 2

UL 50:15, Ed. 13 • UL 50E:15, Ed. 2

IP66

CSA-C22.2 No. 60529:16

THE PF2200-DB IS PENDING CERTIFICATION TO THE FOLLOWING STANDARDS

Electrical Burner Control System

PENDING: CAN/CSA-C22.2 No. 60730-2-5:14 • ANSI Z21.20 / UL 60730-2-5:14

PENDING: CAN/CSA-C22.2 No. 60730-1:13 • UL 60730-1:09

Class I Div 2 Group A, B, C & D, T4A (Class I, Zone 2, Group IIC – US Only)

PENDING: CAN/CSA-C22.2 No. 213-17 • UL 121201, Ed. 9

PENDING: CAN/CSA-C22.2 No. 0-10:15

CONTROLLER INTERFACE

THE PF2200-DB CONTROLLER CONSISTS OF 3 MAIN SCREENS:

1. **STATUS SCREEN** – Always-on display that shows real-time input device readings, burner states and alerts.

ALERT TYPES DISPLAYED IN THE ALERTS PANE OF THE STATUS SCREEN:

- Alarm - Prevents a burner from entering any running state.
- Wait – Prevents a burner from entering any fuel state.
- Main Permissive – Prevents a burner from entering any main fuel state.
- Warning – Displayed on screen only - does not affect burner state.

STATUS			A - Alarm
			B - Ready
BATH (°C)		OUTLET (°C)	
186.5 [197]		107.5 [128]	
STACK (°C)	LEVEL (L)	PRESSURE UP (psi)	
557.8 [580]	146.7 [208]	45.6 [70]	
PRESSURE A	PRESSURE B	FIRING RATE	
OPEN	CLOSED	0%	
☉ Alarm ⌘ Wait ▲ Warning			












SETTINGS			A - Alarm
			B - Ready
Temps	Inputs		
Bath	Level/Flow	Aux 1	
Outlet / Stack B	Pressure Up	Aux 2	
Stack	Pressure A		
Aux	Pressure B		
Proc Control	Setup		
PID Control	Units		



2. **SETTINGS SCREEN** – Screen containing all the configuration settings required to set up the system
3. **SYSTEM SCREEN** – Screen containing tools for data logging and settings backup as well as a suite of diagnostic information for troubleshooting

SYSTEM			A - Alarm
			B - Ready
Diagnostics		Logging	
Temperature	Power	Events	
Inputs	Run Times	Data	
Outputs	Modbus		
Flame	Keypad		
Customization	Firmware		
Status Priority	Info		

BUTTONS	FUNCTIONS
	<p>Start the system</p> <p>OR</p> <p>Start individual burners from the Ready state.</p>
	<p>Stop the system or individual burners while running.</p> <p>* If user shut-down is a required safety function, the ESD input or External Ignition Switch must be used instead of the Stop button.</p>
	<p>Return to previous screen from an on-screen menu</p>
	<p>Cycle through Status, Settings, and System screens</p>
	<p>Display keypad functionality help screen</p>
	<p>Switch to Commissioner Mode to see all available settings</p> <p>OR</p> <p>Switch to Operator Mode to see only essential settings and setpoints</p>
	<p>Navigate Menus and highlight items</p>
	<p>Select highlighted item</p>
	<p>Change Status screen display mode</p> <hr/> <p>Make incremental changes to numeric settings</p> <p>OR</p> <p>Scroll Event Log by full page</p>

TEMPERATURE SETTINGS

NAME	DEFAULT	OPTIONS/RANGE	DESCRIPTION
HIGH TEMP SETPOINT	90 °C	0 °C - 1350 °C	Temperature threshold at which the system shuts down.
	194 °F	32 °F - 2462 °F	
High Temp Setpoint must be greater than Pilot Off Setpoint If Type setting is set to RTD, High Temp Setpoint must be less than 850 °C (1562 °F)			
PILOT OFF SETPOINT	85 °C	0 °C - 1350 °C	Temperature threshold at which the system turns off the pilot valve(s).
	185 °F	32 °F - 2462 °F	
Pilot Off Setpoint must be greater than Main Off Setpoint and less than High Temp Setpoint			
MAIN OFF SETPOINT	85 °C	0 °C - 1350 °C	Temperature threshold at which the system turns off the main valve(s).
	185 °F	32 °F - 2462 °F	
Main Off Setpoint must be greater than Process Setpoint and less than Pilot Off Setpoint			
PROCESS SETPOINT	80 °C	0 °C - 1350 °C	Temperature that the system attempts to maintain when in Process Control mode.
	176 °F	32 °F - 2462 °F	
Process Setpoint must be greater than Low Temp Setpoint and less than Main Off Setpoint			
LOW TEMP SETPOINT	0 °C	0 °C - 1350 °C	Temperature threshold at which, if not exceeded, the system warns the user.
	32 °F	32 °F - 2462 °F	
Low Temp Setpoint must be less than Process Setpoint			
DEADBAND	2 °C	0 °C - 100 °C	The deadband prevents bouncing between states when the input reading is close to the corresponding setpoint.
	3.6 °F	0 °F - 180 °F	

INPUT SETTINGS

NAME	DEFAULT	OPTIONS/RANGE	DESCRIPTION
4-20 LOW TRIP SET-POINT	12 mA	4 mA - 20 mA	Input threshold at which the system will initiate a low-trip event in accordance with the 4-20 Low Trip Mode setting.
Type must be set to 4-20			
4-20 HIGH TRIP SETPOINT	19.6 mA	4 mA - 20 mA	Input threshold at which the system will initiate a high-trip event in accordance with the 4-20 High Trip Mode setting.
Type must bet set to 4-20			
4-20 DEADBAND	0.2 mA	0 mA - 1 mA	The deadband prevents bouncing between states when the input reading is close to the corresponding trip point.
<p>To clear a low trip, input must be greater than 4-20 Low Trip plus deadband.</p> <p>To clear a high trip, input must be less than 4-20 High Trip minus deadband.</p>			


PROCESS CONTROL SETTINGS

NAME	DEFAULT	OPTIONS/RANGE	DESCRIPTION
RAMP TIME	10 sec	0 sec - 255 sec	Once the system enters process control state after light off delay it will slowly ramp to the requested firing rate over this time.


SETTINGS MODIFICATION

DROP DOWN MENU SETTINGS

ACCEPTED CHANGE METHOD

SETTINGS 		A - Ready
Bath Temperature		
Type	RTD	B - Ready
Input	Dual	
Mode	Process Control	
High Temp Setpoint		90.0 °C
Pilot Off Setpoint		85.0 °C
Main Off Setpoint		85.0 °C
Process Setpoint		80.0 °C
Low Temp Setpoint		0.0 °C
Deadband		2.0 °C

OK

SETTINGS 		A - Ready
Bath Temperature		
Type	TC	B - Ready
Input	RTD	
Mode	RTD	
High Temp Setpoint		90.0 °C
Pilot Off Setpoint		85.0 °C
Main Off Setpoint		85.0 °C
Process Setpoint		80.0 °C
Low Temp Setpoint		0.0 °C
Deadband		2.0 °C

+

-

▼

▲

CHANGE VALUE


OK

ACCEPT

↶

CANCEL

QUICK SETTING ADJUSTMENT METHOD

SETTINGS 		A - Ready
Bath Temperature		
Type	RTD	B - Ready
Input	Dual	
Mode	Process Control	
High Temp Setpoint		90.0 °C
Pilot Off Setpoint		85.0 °C
Main Off Setpoint		85.0 °C
Process Setpoint		80.0 °C
Low Temp Setpoint		0.0 °C
Deadband		2.0 °C

+

-

CHANGE VALUE

*Note: Settings modifications made using the Quick Settings Adjustment Method take effect immediately.

SETTINGS MODIFICATION

NUMERIC SETTINGS

QUICK SETTING ADJUSTMENT METHOD

SETTINGS	A - Ready
Bath Temperature	B - Ready
High Temp Setpoint	90.0 °C
Pilot Off Setpoint	85.0 °C
Main Off Setpoint	85.0 °C
Process Setpoint	80.0 °C
Low Temp Setpoint	0.0 °C
Deadband	2.0 °C



CHANGE VALUE

*Note: Settings modifications made using the Quick Settings Adjustment Method take effect immediately.

SYSTEM TOOLS

Date	Time	Description
Oct 30	16:28:02	Operator Present
Sep 30	7:41:36	Operator Timeout
Sep 30	7:36:57	Burner B Entered State: Main
Sep 30	7:36:45	Burner A Entered State: Main
Sep 30	7:31:57	Burner B Entered State: Pilot
Sep 30	7:31:50	Burner B Entered State: Ignition
Sep 30	7:31:45	Wait Cleared: Waiting for Burner A Ignition
Sep 30	7:31:45	Burner A Entered State: Pilot
Sep 30	7:31:40	Burner A Entered State: Ignition
Sep 30	7:31:40	Wait: Waiting for Burner A Ignition

THE EVENT LOG SCREEN

(SYSTEM > LOGGING > EVENTS)

Displays a full history of system events for reference and troubleshooting. Events are continuously recorded to the USB storage device when inserted.

SYSTEM A - Ready
Data Log B - Ready

- 4-20 Aux In 2
- Firing Rate
- System
- System
- System
- Amb
- Pilot
- Pilot B Flame Strength

20.1% Full

* Space Used 179/891 MB
* Space Free 712 MB
* Time Until Full: -611.2 Days


Accept Cancel Statistics Clear Data

THE DATA LOGGING TOOL

(SYSTEM > LOGGING > DATA)

Logs input/output readings for up to 8 user selectable pieces of system information to the USB storage device. The data is logged in 15 second intervals and saved to the USB storage device regularly.

SYSTEM TOOLS

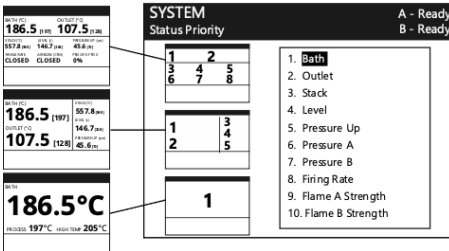


THE STATUS PRIORITY TOOL

(SYSTEM > CUSTOMIZATION > STATUS PRIORITY)

Allows configuration of the items

displayed on the main Status screen.

Use and to select a status element and and to move it up or down the priority list.

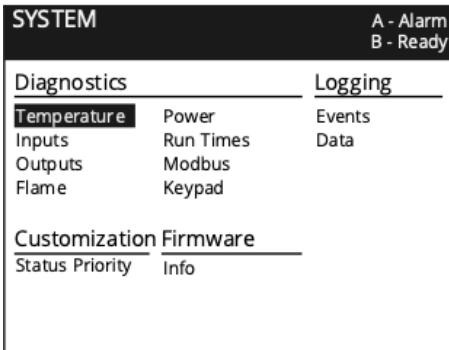

THE PF2200-DB DIAGNOSTIC MENUS

(SYSTEM > DIAGNOSTICS)

Contain useful real-time system input and output measurements, run metrics and useful troubleshooting information.

OPERATING SEQUENCE


The PF2200-DB utilizes a state-based control scheme to safely monitor and control each burner individually. Each system state has specific entry and exit requirements and defined output behavior.

NOTE: The current state of each burner is always displayed in the Status Bar at the top of the User Interface screen.

STATE TABLE

STATE NAME	STOPPED STATE	RUNNING STATE	FUEL STATE	MAIN STATE	COIL OUTPUT	PILOT OUTPUT	SSV OUTPUT
Power On	Yes	No	No	No	De-energized	De-energized	De-energized
Alarm	Yes	No	No	No	De-energized	De-energized	De-energized
Ready	Yes	No	No	No	De-energized	De-energized	De-energized
Lockout	Yes	No	No	No	De-energized	De-energized	De-energized
Waiting	No	Yes	No	No	De-energized	De-energized	De-energized
Ignition	No	Yes	Yes	No	Energized	Energized	De-energized
Pilot	No	Yes	Yes	No	De-energized	Energized	De-energized
Main Light Off – Requesting Light Off	No	Yes	Yes	Yes	De-energized	Energized	De-energized
Main Light Off – Main Delay	No	Yes	Yes	Yes	De-energized	Energized	Energized
Process Control	No	Yes	Yes	Yes	De-energized	Energized	Energized

STATE DIAGRAM

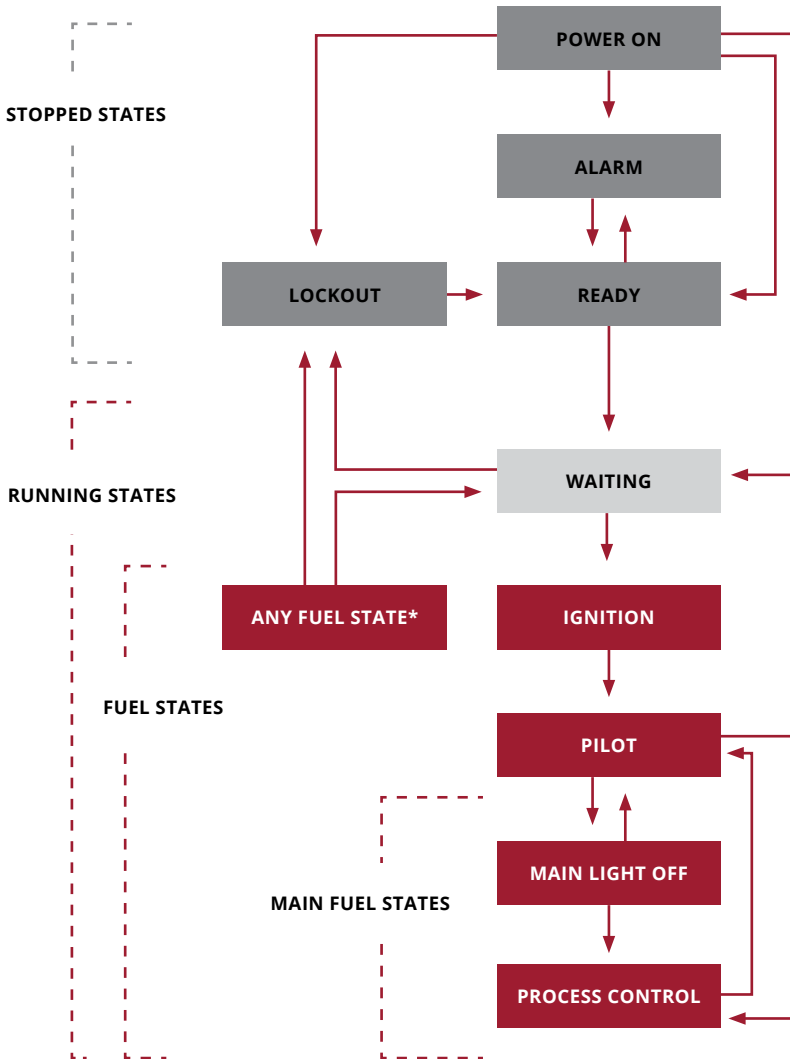

STATUS LED BEHAVIOR

BURNER A STATE	BURNER B STATE	CONDITION	BEHAVIOR
Power On	Power On	Any	Green-Amber-Red
Alarm	Alarm	Any	Slow blinking Red
Ready	Ready	Any	Solid Red
Lockout	Any stopped state	Any	Fast flashing Red
Any stopped state	Lockout	Any	
Lockout	Any running state	Any	Fast alternating Green and red
Any running state	Lockout	Any	
Any running state	Alarm	Any	Slow alternating Green and Red
Alarm	Any running state	Any	
Any running state	Ready	Any	Slow alternating Green and Amber
Ready	Any running state	Any	
Any running state	Any running state	No waits present ¹ No warnings present	Solid Green
		Wait present ¹ No warnings present	Slow blinking Green
		Wait present ¹ Warning present	Slow blinking Amber
		No waits present ¹ Warning present	Solid Amber

¹ With the exception of Waiting on High Process Temp.

TROUBLESHOOTING

PROBLEM	PROPOSED SOLUTIONS
System has visible flame but cannot detect	1. Ensure pilot assembly, flame rod, and the gap between are fully engulfed in flame. If not, adjust rod position
	2. Ensure flame detection wiring does not exceed the recommended maximum length
	3. Ensure burner assembly has a low impedance path to Ion- terminal of BMS
	4. For longer run lengths, ensure ignition cable is used to avoid ground-loading
Card is unresponsive or BMS card will not communicate with User Interface card	1. Ensure the Status LEDs for both cards are functioning. If status LED is not functioning, cycle power (if safe to do so) and check again.
	2. Check the wiring between the BMS card and the User Interface Card.
	3. Ensure that the firmware versions of the BMS card and UI card are matching.
Ignition transformer "clicks" but no visible spark	1. Ensure all wires in the ignition path are properly terminated and that there is a low impedance path from the primary-windings to the BMS card as well as the secondary-windings to the ignition rod.
	2. Ensure the gap between the ignition rod and the burner housing is between 2mm and 8mm
Solenoids are not turning on, or turning on then over time turn off	<p>Ensure the solenoid is wired correctly and to the appropriate terminals. To ensure proper solenoid wiring, a multi-meter in OHM mode can be used to measure the resistance between the + and - terminal of the associated output.</p> 1. Note: this measurement should be done with the BMS card powered off. If properly wired, the multi-meter should read a resistance of the solenoid coil plus the run length (i.e. if the multimeter reads open, there is likely a problem with wiring).
	2. Ensure the PWM setting is correct for the appropriate solenoid. If using a peak-and-hold solenoid, the appropriate PWM setting can be found in the solenoid data sheet. Typically add a margin of 5-10% to allow for temperature variance. If using a non-peak-and-hold solenoid, ensure the PWM setting is set to 100%.
Digital input will not energize	1. Ensure the input is properly wired. In the case of a dry contact, ensure the PWR terminal is connected and is sourcing the correct voltage.
	2. Ensure adequate amount of wetting current is being applied to the contact. Run a current meter in series with the digital input switch to verify the current applied. If the wetting current is not adequate, the digital input either has too high of an impedance or the wiring has been compromised.



UNITED STATES

1.801.796.5127

321 South, 1250 West Suite 1
Lindon, UT 84042, USA

support@profireenergy.com

CANADA

1.780.960.5278

9671 - 283 Street
Acheson, AB T7X 6J6, CAN

support@profireenergy.com